

ORDINANCE NO. 233

AN ORDINANCE ESTABLISHING REQUIREMENTS FOR PRIVATE SEWAGE HOLDING TANKS AND PRIVATE WATER TANKS IN THE CITY OF LINN VALLEY, KANSAS.

IT IS HEREBY ORDAINED BY THE GOVERNING BODY OF THE CITY OF LINN VALLEY, KANSAS:

Section 1. Private sewage holding tanks and private water storage tanks (cisterns) shall:

- a) Be constructed of precast, reinforced concrete.
- b) Comply with the standards of the Kansas Department of Health and environment (KDHE)
- c) Have a minimum capacity of 1500 gallons.
- d) The tank bedding layer below the tank shall be compacted and have a minimum 4" level gravel base. The holding tank shall be back filled evenly on all four sides in 12" compaction lifts.
- e) The location of the sewer holding tank shall be such as to maintain not less then the following required separation distances:
 - 50' from a pond or lake not used for drinking water.
 - 5' of undisturbed soil between a (cistern) water holding tank and the sewer holding tank.
 - 10' from a potable water line.
 - 5' from a habitable building
 - 10' from the property line.
 - 15' from the front property line
- f) Be accessible to a pumping vehicle, within a maximum distance of twenty feet between the vehicle and the removable lid of the tank.

Section 2. All ordinances and parts of ordinances in conflict with this ordinance are hereby repealed as to the conflicting portions.


Section 3. This ordinance shall take effect and be in force from and after its publication of summary in the official newspaper of the City and publication of the entire ordinance on the official website www.linnvalleyks.com for one week following the aforesaid newspaper publication.

Passed and approved this 15th day of November 2021.



Cindy Smith, Mayor

Attest:

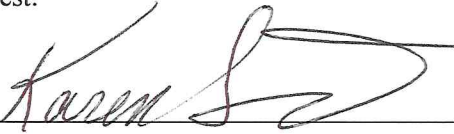

Karen Siffing, City Clerk

